

Ordering Instructions

STEP 1. Complete the QuickShip Part Number

Example of completed QuickShip Part Number: QSRM4D-1L35K-8-M-SA-L3EM-PA-3

Optics											
QSRM4D	1L35K	8		M	SA	L3	EM	PA	3		
Series	Color Temp	Length	Up	Down	Finish	LL/Driver	Circuitry	Mounting	Voltage	Controls	Options

STEP 2. Row Configurations

Part 1) Enter quantity of runs under the QTY column

QTY	Nominal Length	Run Length Overall	Alone Length	Start Length	Mid Length(s)	End Length	STD = Standard w/EM = With Emergency	Diagram
4'	1225 [48.2]	4					STD w/EM	
8'	2442 [96.1]	8					STD w/EM	
12'	3661 [144.1]	12					STD w/EM	


Example: 5 8-ft Runs with Emergency

Part 2) Select one pod to indicate desired emergency lighting location


LEGEND

- Standard (STD) Wire Entry Location
- Emergency (EM) Lighting Location
- Emergency or Battery Wire Entry Location

Selection examples in a RM2/RM4 28 ft run:

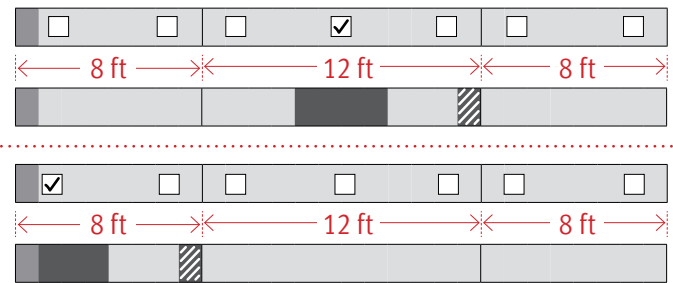

Selection examples in a RMEP6/8 20 ft run:




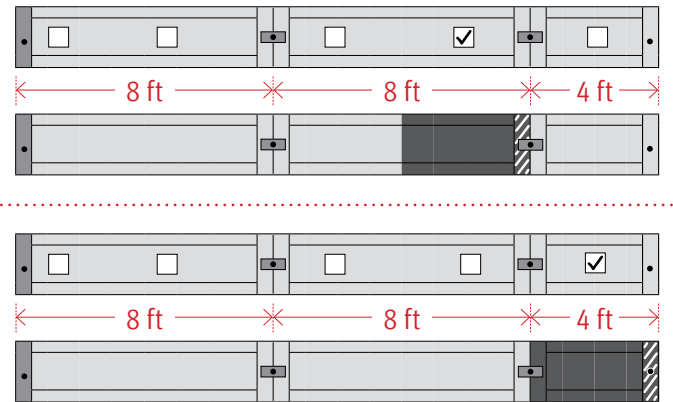


STEP 3. Submit Forms

Send completed forms to the appropriate inside sales representative.

Transform TRA14 Information

- There is one driver box per fixture. For example, a continuous row with 6 fixtures will have a total of 6 driver boxes.
- Maximum recommended remote mounting distance is 34ft. (18AWG wire at 2% power loss).
- Power over aircraft cable is at each mounting location.
- Transform comes only with Power over aircraft cable.
- Excess power over aircraft cable must not be cut. The Transform will become inoperative if the power over aircraft cable is cut.

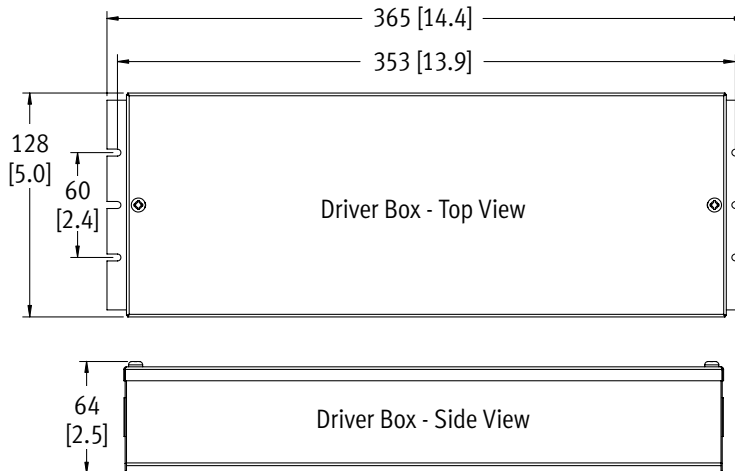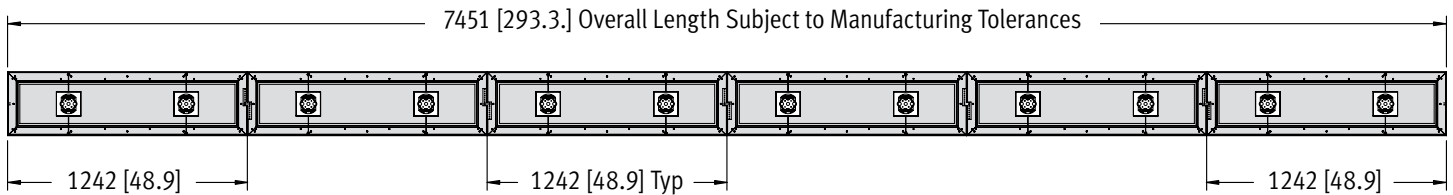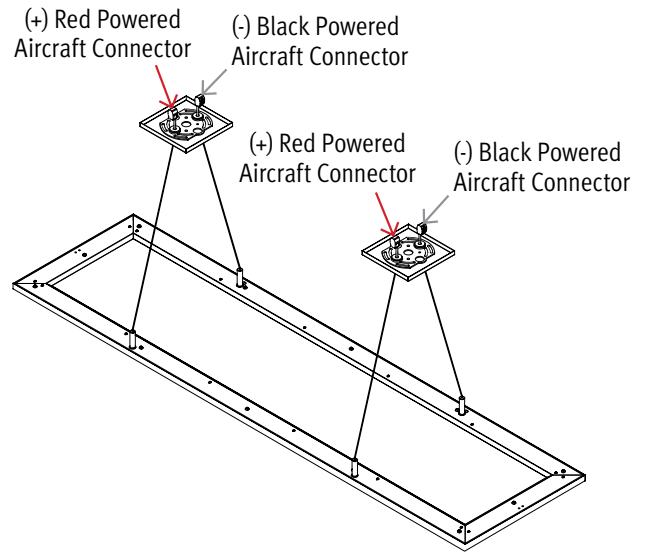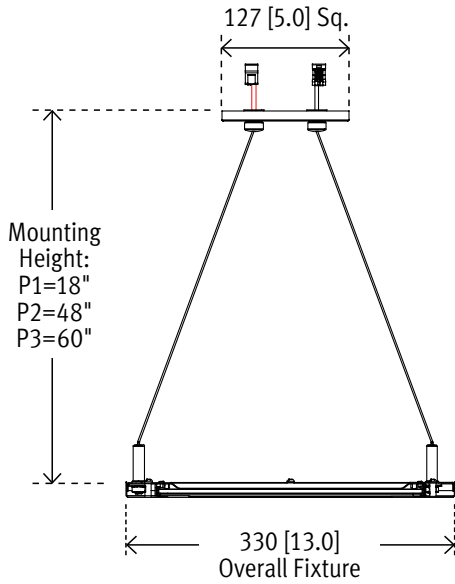


QuickShip Terms & Conditions

1. Shipment within 10 business days.
2. Day one begins next business day after order is entered (order entered as QuickShip is automatically released by the system).
3. Order must be designated with "QS" in front of the part number.
4. Rail 2, Rail 4 and Stail are available at 3000K and 3500K and 80 CRI.
5. Transform is available at 3500K and 80 CRI.
6. Dual circuit wiring is available for Rail 2, Rail 4 and Stail.
7. All luminaires offered only in standard finishes.
8. No integral control options.
9. No louvers.
10. No changes or cancellations permitted after receipt of order.
11. Large orders are subject to review. We will do our best to accommodate.
12. Minimum 20 linear feet per order or 5 units of standard runs to qualify for QS program.
13. Installing contractor is responsible to ensure that fixture wiring adheres to local codes.
14. All other standard Metalumen Terms and Conditions apply.



Transform TRA14

Direct / Indirect



Pendant

Ordering Instructions - please refer to page 4 for detailed Ordering Instructions

STEP 1. QuickShip Part Number

STEP 2. Row Configurations

STEP 3. Submit Forms

STEP 1. QuickShip PART NUMBER

Example Part Number: QSTRA14-2L35K-4-AR-W-L31-P1-1-NR-N

QSTRA14 Series	2L35K Color Temp	4 Length	AR Optics	W Finish	1 LL/Driver	1 Circuitry	1 Mounting	120 Voltage	N Controls	R Driver Loc.	N Options
--------------------------	----------------------------	--------------------	---------------------	--------------------	-----------------------	-----------------------	----------------------	-----------------------	----------------------	-------------------------	---------------------

Color Temp	Optics	Light Level (LL) / Driver				Circuitry	Voltage	Controls
2L35K = 3500K	AR = AccuRay®	Performance at 3500K 0-10V Dimming (Standard)				1 = 1 Circuit	1 = 120 V	N = None
Length	Finish	Light Level	Lumens	Wattage	Efficacy (LPW)	Mounting *	2 = 277 V	Driver Location
4 = 4 ft	W = White	L1	2399	23	104	P1 = Pendant Aircraft Cable 18"	3 = 347 V	R = Remote
R = Continuous Rows (See p.22)		L2	4639	49	94	P2 = Pendant Aircraft Cable 48"	4 = UNV (120-277V)	Options
		L3	6749	74	91	P3 = Pendant Aircraft Cable 60"		N = None
		L4	7679	85	90			
		Based on 4ft sections. See a more detailed charts on page 23						

* Transform comes only with Power over aircraft cable. Excess power over aircraft cable must not be cut. The Transform will become inoperative if the power over aircraft cable is cut.

STEP 2. Row Configurations

Part 1) Indicate desired quantity of rows under the QTY column

